




LPT-A-R

**INSTALLER SUPPLIED
24 VAC OPTION**
Connect to the 24V and 24V/DC.
If applicable connect the SIG to a
BAS* and connect the GND.

* Building Automation System (BAS)

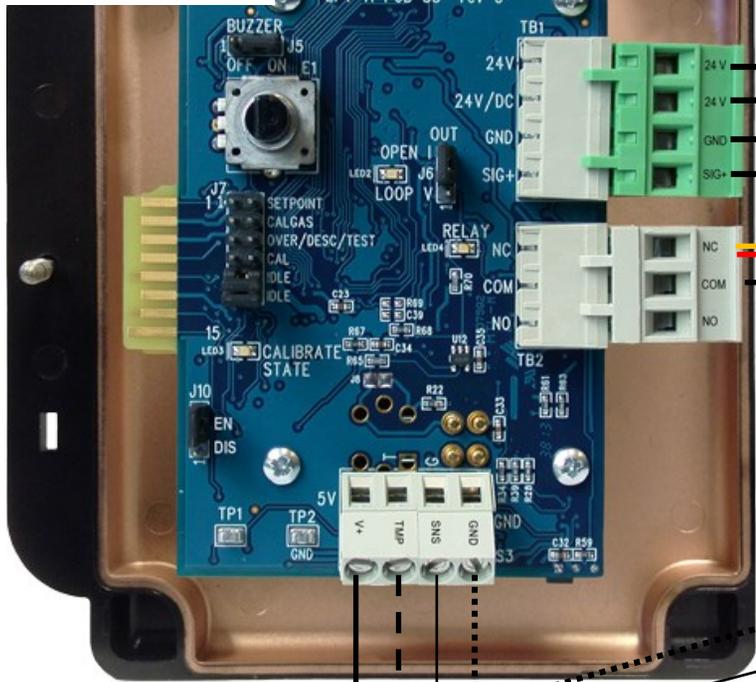

AS SHOWN, STROBE & HORN OPERATE TOGETHER.


TO ENABLE STROBE ONLY, CONNECT THE YELLOW WIRE AND THE BLACK (GND) WIRE.

TO ENABLE HORN ONLY, CONNECT THE RED WIRE AND THE BLACK (GND) WIRE.

RELAY OPERATES IN A
"FAIL SAFE" CONFIGURATION

**LPT-A-R WITH NO
INTERNAL SENSOR**

**ESH-A 4-WIRE ANALOG
REMOTE SENSOR WIRED
TO LPT-A-R SINGLE
CHANNEL ANALOG
TRANSMITTER**

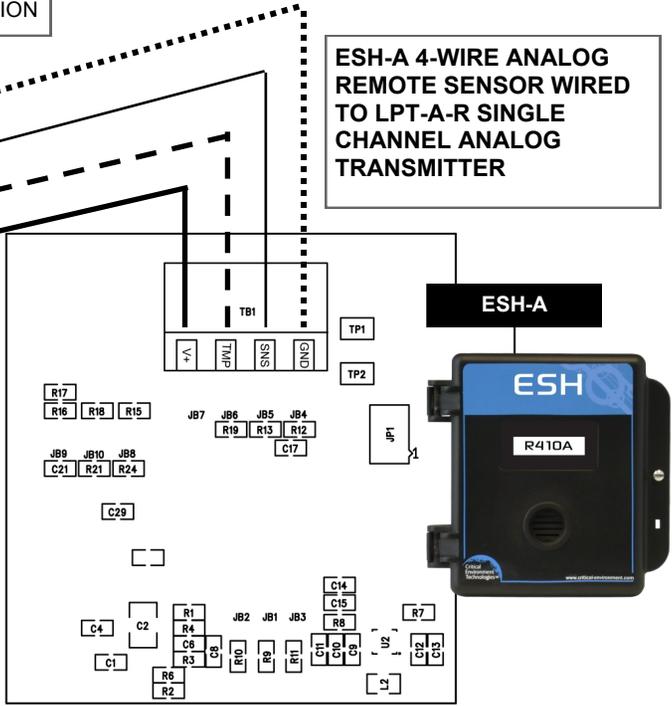

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
www.critical-environment.com
**24 VAC SUPPLIED POWER TO LPT-A-R WITH ESH-A REMOTE SENSOR
AND RSH-24VDC USING RELAY WIRING CONNECTION DRAWING
REV-A July 5, 2017**