




INTERNAL SENSOR
(ONE OF MANY
AVAILABLE, TYPE OF
GAS SENSOR DO NOT
CHANGE WIRING
CONFIGURATION)


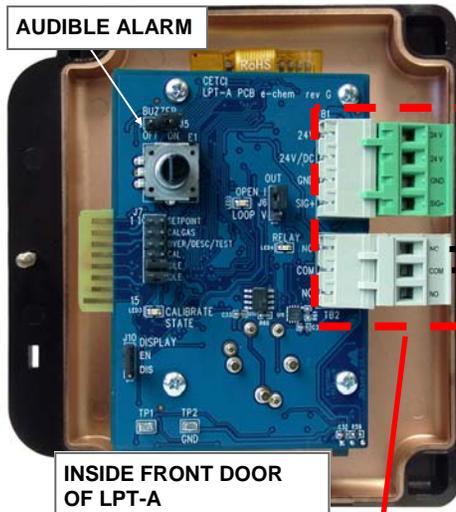


AUDIBLE ALARM

INSIDE FRONT DOOR
OF LPT-A

RELAY CONTROL WIRING TERMINAL.
CONNECT TO COM AND NC (NORMALLY CLOSED)
DO NOT USE SOLID CORE WIRE.
RELAYS OPERATE IN "FAIL SAFE" CONFIGURATION

INSTALLER SUPPLIED
24VDC POWER

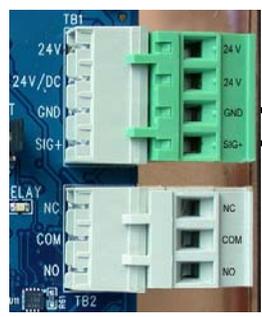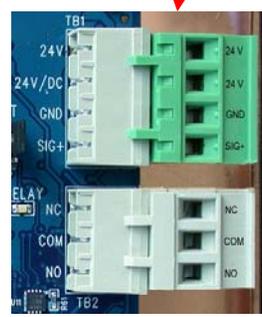

ETC.

DDC GND

DDC CHAN 1

DDC CHAN 2

ETC.

THIS LPT-A AND DDC COMBINATION MAKES A
ONE CHANNEL GAS DETECTION MONITORING SYSTEM

CRITICAL ENVIRONMENT
TECHNOLOGIES CANADA INC.
www.critical-environment.com


LPT-A TO DDC WIRING (24VDC)
CONNECTION PHOTO DRAWING
March 31, 2016



INTERNAL SENSOR
(ONE OF MANY
AVAILABLE, TYPE OF
GAS SENSOR DO NOT
CHANGE WIRING
CONFIGURATION)

AUDIBLE ALARM


INSIDE FRONT DOOR
OF LPT-A

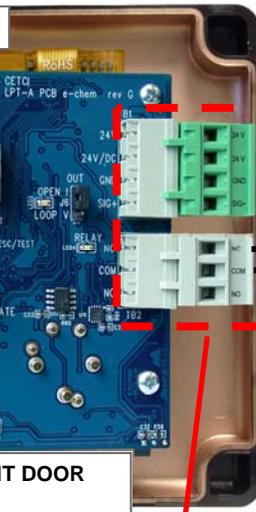

RELAY CONTROL WIRING TERMINAL.
CONNECT TO COM AND NC (NORMALLY CLOSED)
DO NOT USE SOLID CORE WIRE.
RELAYS OPERATE IN "FAIL SAFE" CONFIGURATION

INSTALLER SUPPLIED
24VAC POWER
ISOLATED SUPPLY

NO CONNECTION TO
LPT-A SUPPLY

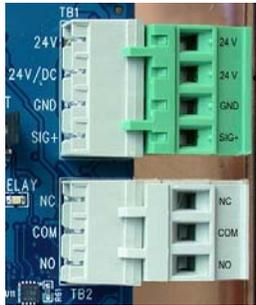

ETC.

DDC GND

DDC CHAN 1

DDC CHAN 2

ETC.

THIS LPT-A AND DDC COMBINATION MAKES A
ONE CHANNEL GAS DETECTION MONITORING SYSTEM

CRITICAL ENVIRONMENT
TECHNOLOGIES CANADA INC.
www.critical-environment.com

LPT-A TO DDC WIRING (24VAC)
CONNECTION PHOTO DRAWING
March 31, 2016