

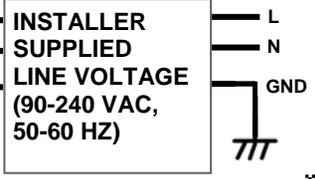



A1 TO A4 ARE INDIVIDUAL 4-20 mA SIGNAL WIRE CONNECTIONS FOR EACH TRANSMITTERS

THREE RELAY CONTROL WIRING TERMINALS. CONNECT TO COM & NC. DO NOT USE SOLID CORE WIRE.
RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.



DAISY-CHAIN POWER & GND WIRES RUNNING TO ADDITIONAL ANALOG TRANSMITTERS. NOTE THAT ONE SIGNAL WIRE MUST BE PULLED FOR EACH ADDITIONAL TRANSMITTER ADDED.

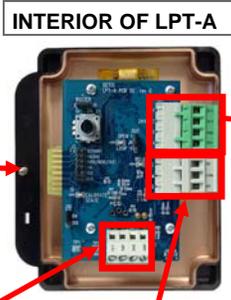


CONNECTION TERMINAL FOR REMOTE ESH-A SENSOR.

RELAY CONNECTION 2-AMP @30V RELAY OPERATES IN "FAIL SAFE" CONFIGURATION



INTERIOR OF ART



THIS QCC with LPT-A & ART-B COMBINATION MAKES A TWO CHANNEL GAS DETECTION.

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
www.critical-environment.com
QCC TO REMOTE LPT-A and ART-B ANALOG TRANSMITTERS WIRING CONNECTION DRAWING
REV-A Feb. 3, 2017