



INDIVIDUAL 4-20 mA SIGNAL WIRE FOR EACH LPT


THREE RELAY CONTROL WIRING TERMINALS. CONNECT TO COM & NC. DO NOT USE SOLID CORE WIRE.  
  
RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.



INSTALLER SUPPLIED LINE VOLTAGE (90-240 VAC, 50-60 HZ)



DAISY-CHAIN POWER & GND WIRES RUNNING TO ADDITIONAL LPT-A TRANSMITTERS. NOTE THAT ONE SIGNAL WIRE MUST BE PULLED FOR EACH ADDITIONAL LPT-A TRANSMITTER ADDED.

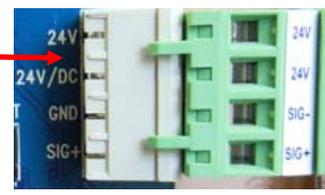

24VDC



24VDC

CONNECTION TERMINAL FOR REMOTE ESH-A SENSOR.

RELAY CONNECTION 2-AMP @30V RELAY OPERATES IN "FAIL SAFE" CONFIGURATION

THIS QCC + LPT-A COMBINATION MAKES A ONE, TWO, THREE OR FOUR CHANNEL GAS DETECTION MONITORING SYSTEM FOR MANY TYPES OF GAS DETECTION APPLICATIONS.

**CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.**  
www.critical-environment.com  
  
**QCC TO REMOTE LPT-A ANALOG BOARD WIRING CONNECTION DRAWING**  
REV-A March 18, 2016