

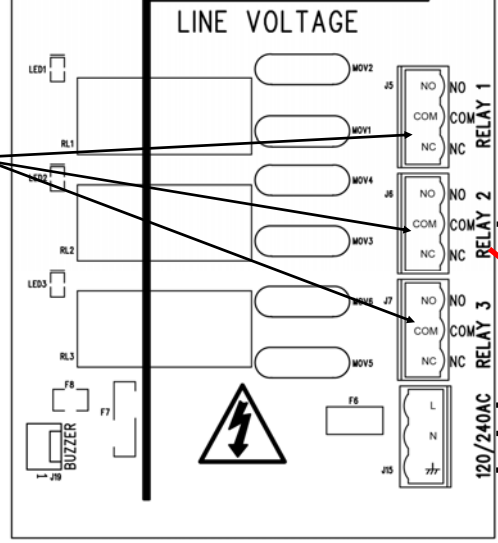


THREE RELAY CONTROL WIRING TERMINALS.
 CONNECT TO COM & NC. **DO NOT USE** SOLID CORE WIRE.
 RELAYS OPERATE IN "FAIL SAFE" CONFIGURATON.

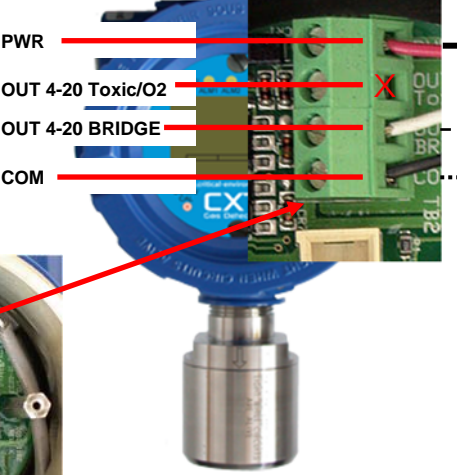

LINE VOLTAGE: 3-CONDUCTOR SHIELDED MINIMUM 18 AWG STRANDED WITHIN CONDUIT.

GREEN WIRE IS USED TO SELECT PATTERN BY MOMENTARILY TOUCHING THE GREEN WIRE TO THE BLACK (GND) WIRE.

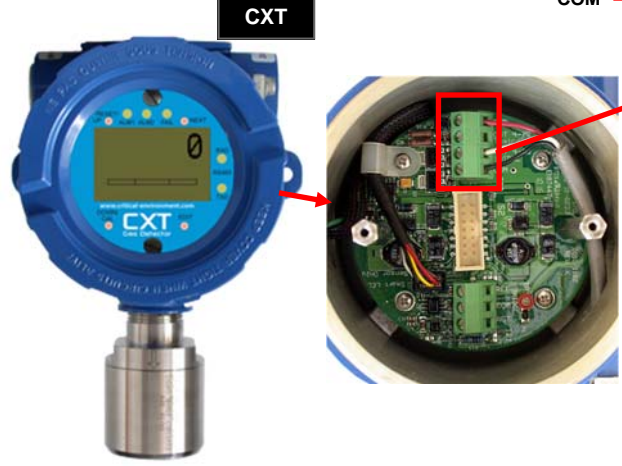

CRITICAL ENVIRONMENT TECHNOLOGIES CANADA INC.
www.critical-environment.com
 QCC-M WITH LPT-A AND CXT ANALOG TRANSMITTERS WITH STROBE USING RELAY WIRING CONNECTION DRAWING
 REV-A July 6, 2017